


LOWE'S OF NASHVILLE
 (FORMER WAL-MART SITE)
 NOLENSVILLE PIKE AT OLD HICKORY BOULEVARD
 METRO PROJECT NOS. 66-SL-111

SEWER PROPOSED: 76" - 8" PVC
 SEWER ABANDONED: 64" - 8"
 REMOVE APPROX. 51' - 84-WI-118 - WATER
 MAIN/FIRE SERVICE AND 234' - FIRE HYDRANT
 LEAD AND F.H. # 12788

OCTOBER 20, 2006 CD 32 MAP 161, PARCEL 82
 ENGINEER - FERRY ENGINEERING (JASON C. MORRIS)

approx. 51' of water main/fire service for existing Wal-Mart
 and 234' of fire hydrant lead including f.h. 12788 to be
 removed and replaced with a 10" private fire service with
 private fire hydrants.

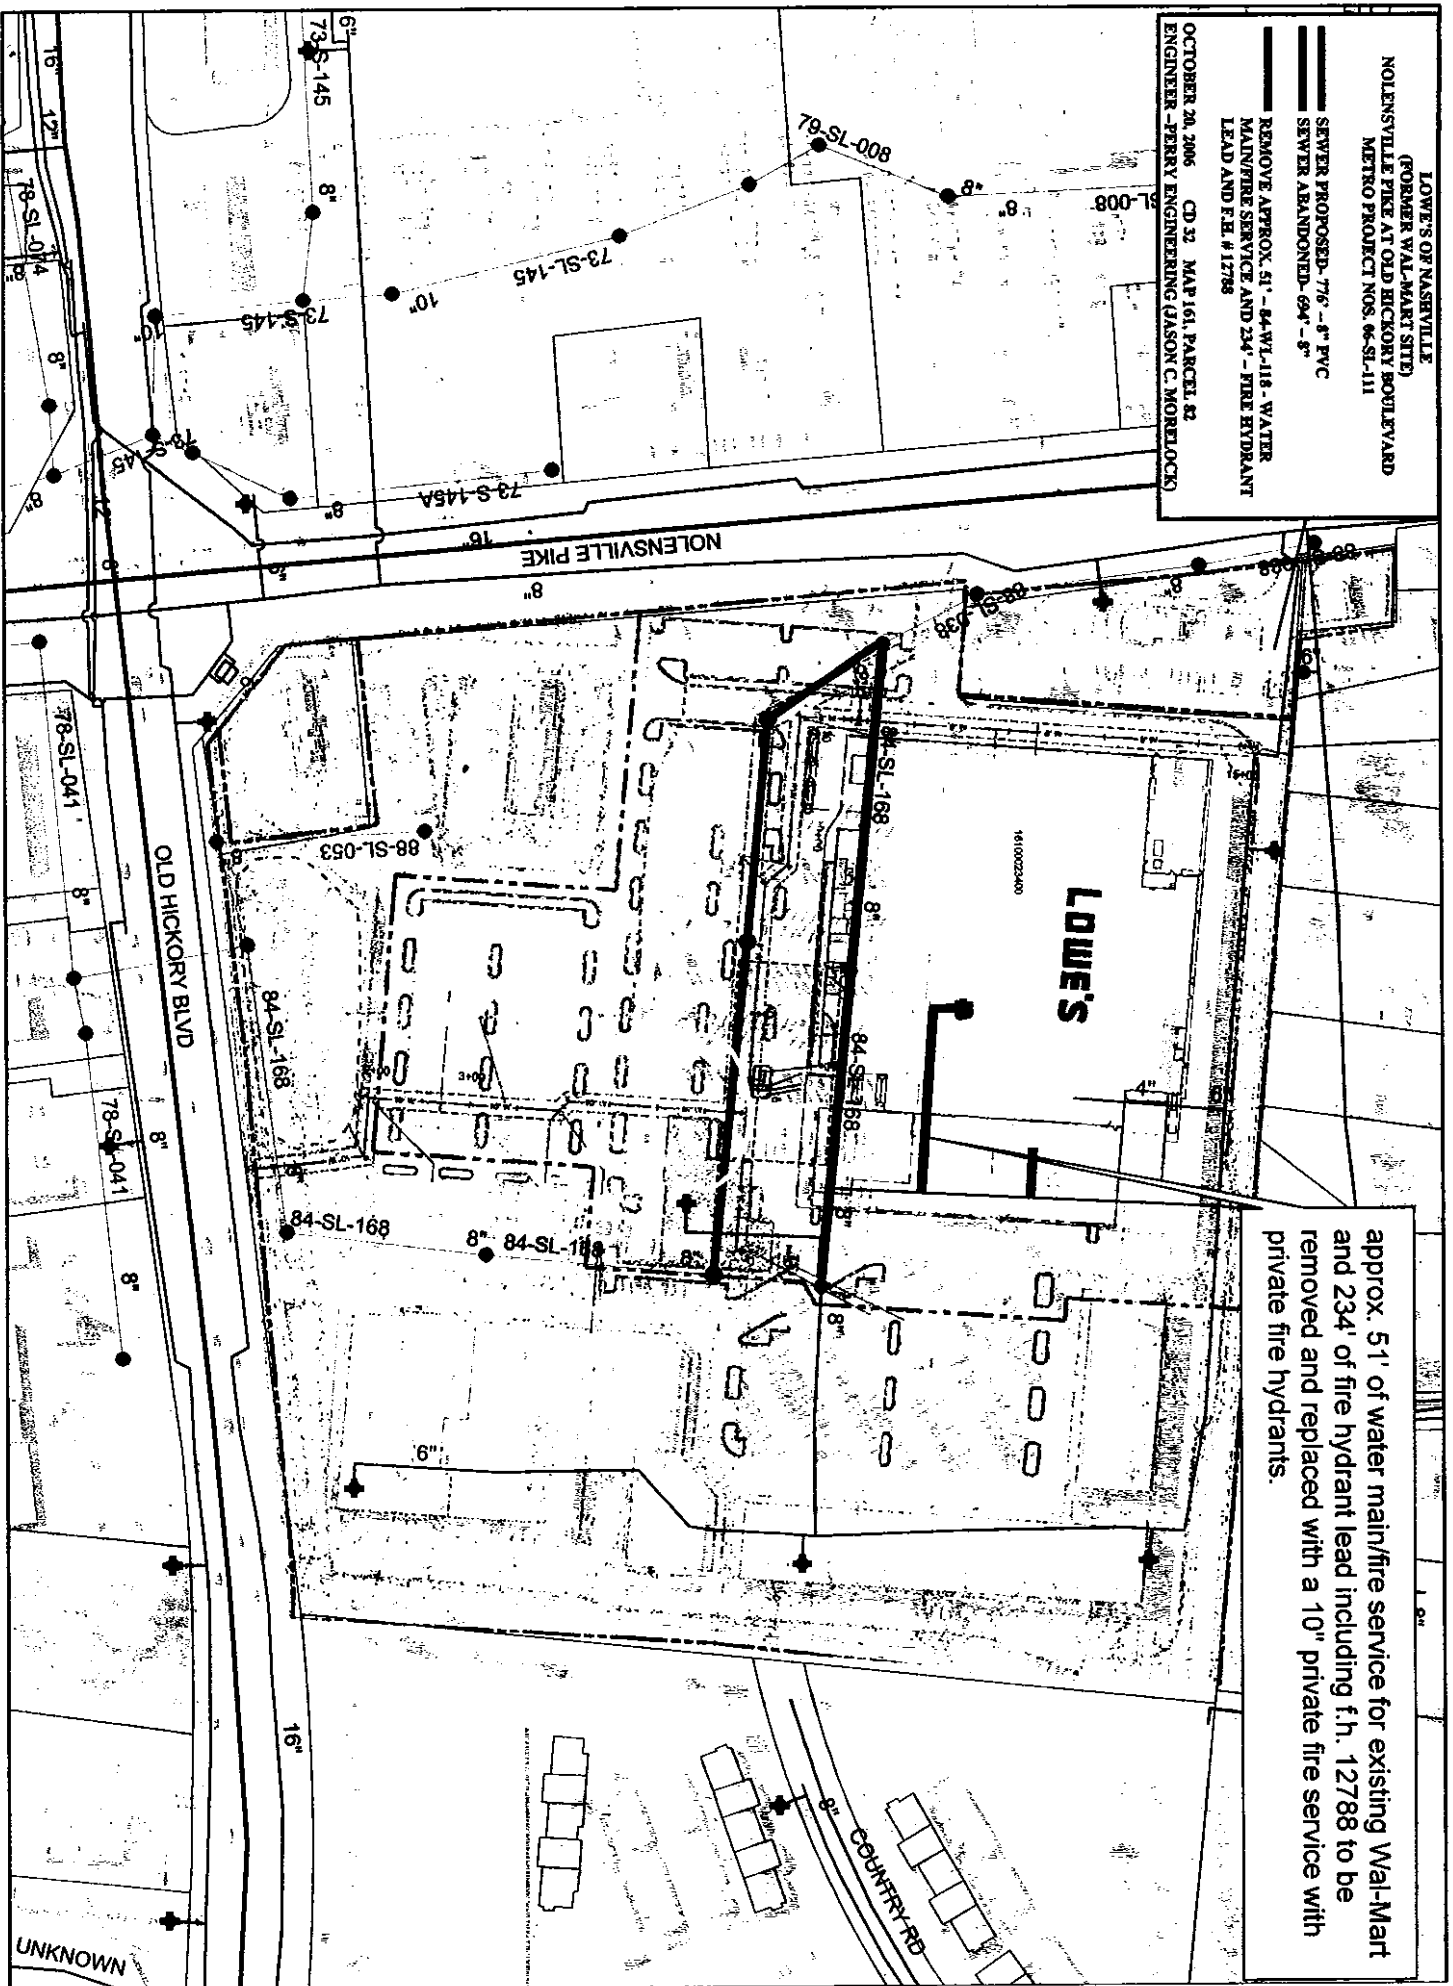

1 inch equals 200 feet