Exhibit 1

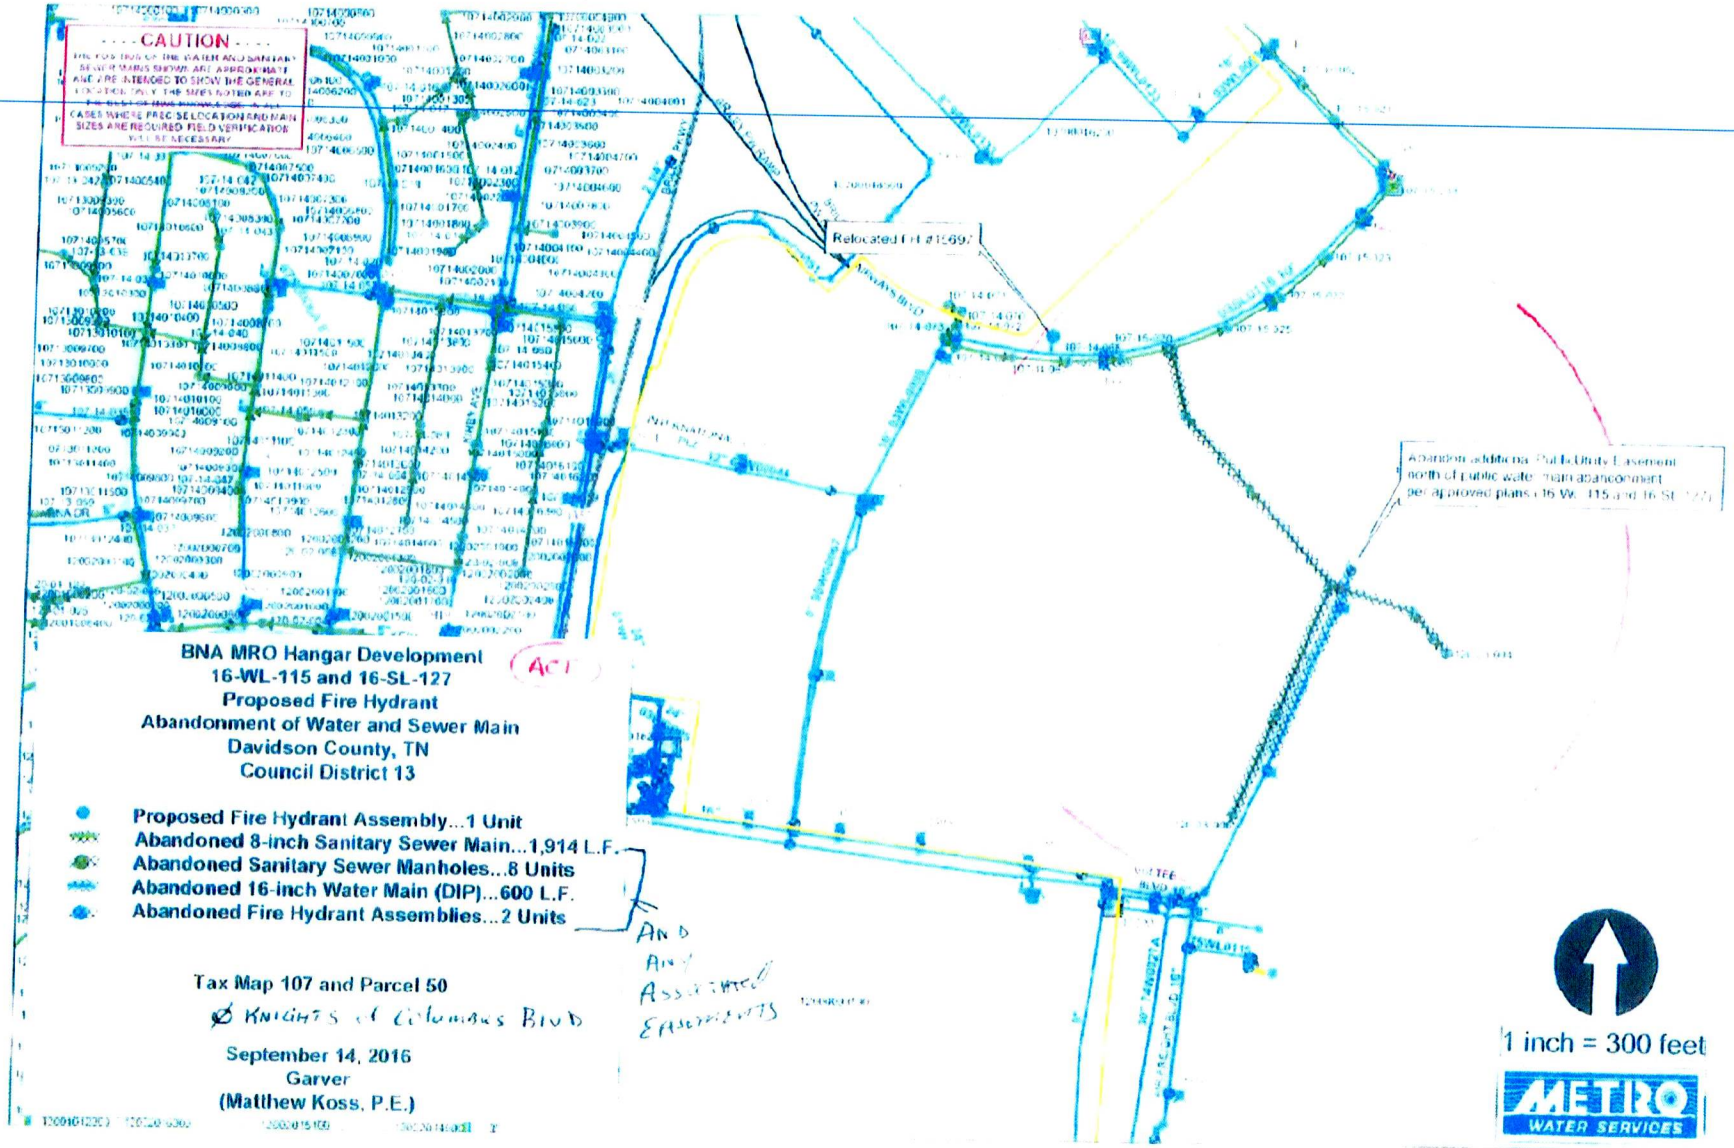
CAUTION
Relocated FH #1569
Abandon additional Public Utility Easement north of public water main abandonment per approved plans 16-WL-115 and 16-SL-127
BNA MRO Hangar Development
16-WL-115 and 16-SL-127
Proposed Fire Hydrant
Abandonment of Water and Sewer Main
Davidson County, TN
Council District 13
Proposed Fire Hydrant Assembly...1 Unit
Abandoned 8-inch Sanitary Sewer Main...1,914 L.F.
Abandoned Sanitary Sewer Manholes...8 Units
Abandoned 16-inch Water Main (DIP)...600 L.F.
Abandoned Fire Hydrant Assemblies...2 Units
AND ANY ASSOCIATED EASEMENTS
Tax Map 107 and Parcel 50
Ø KNIGHTS of Columbus BLVD
September 14, 2016
Garver
(Matthew Koss, P.E.)
1 inch = 300 feet
METRO WATER SERVICES

Exhibit 1

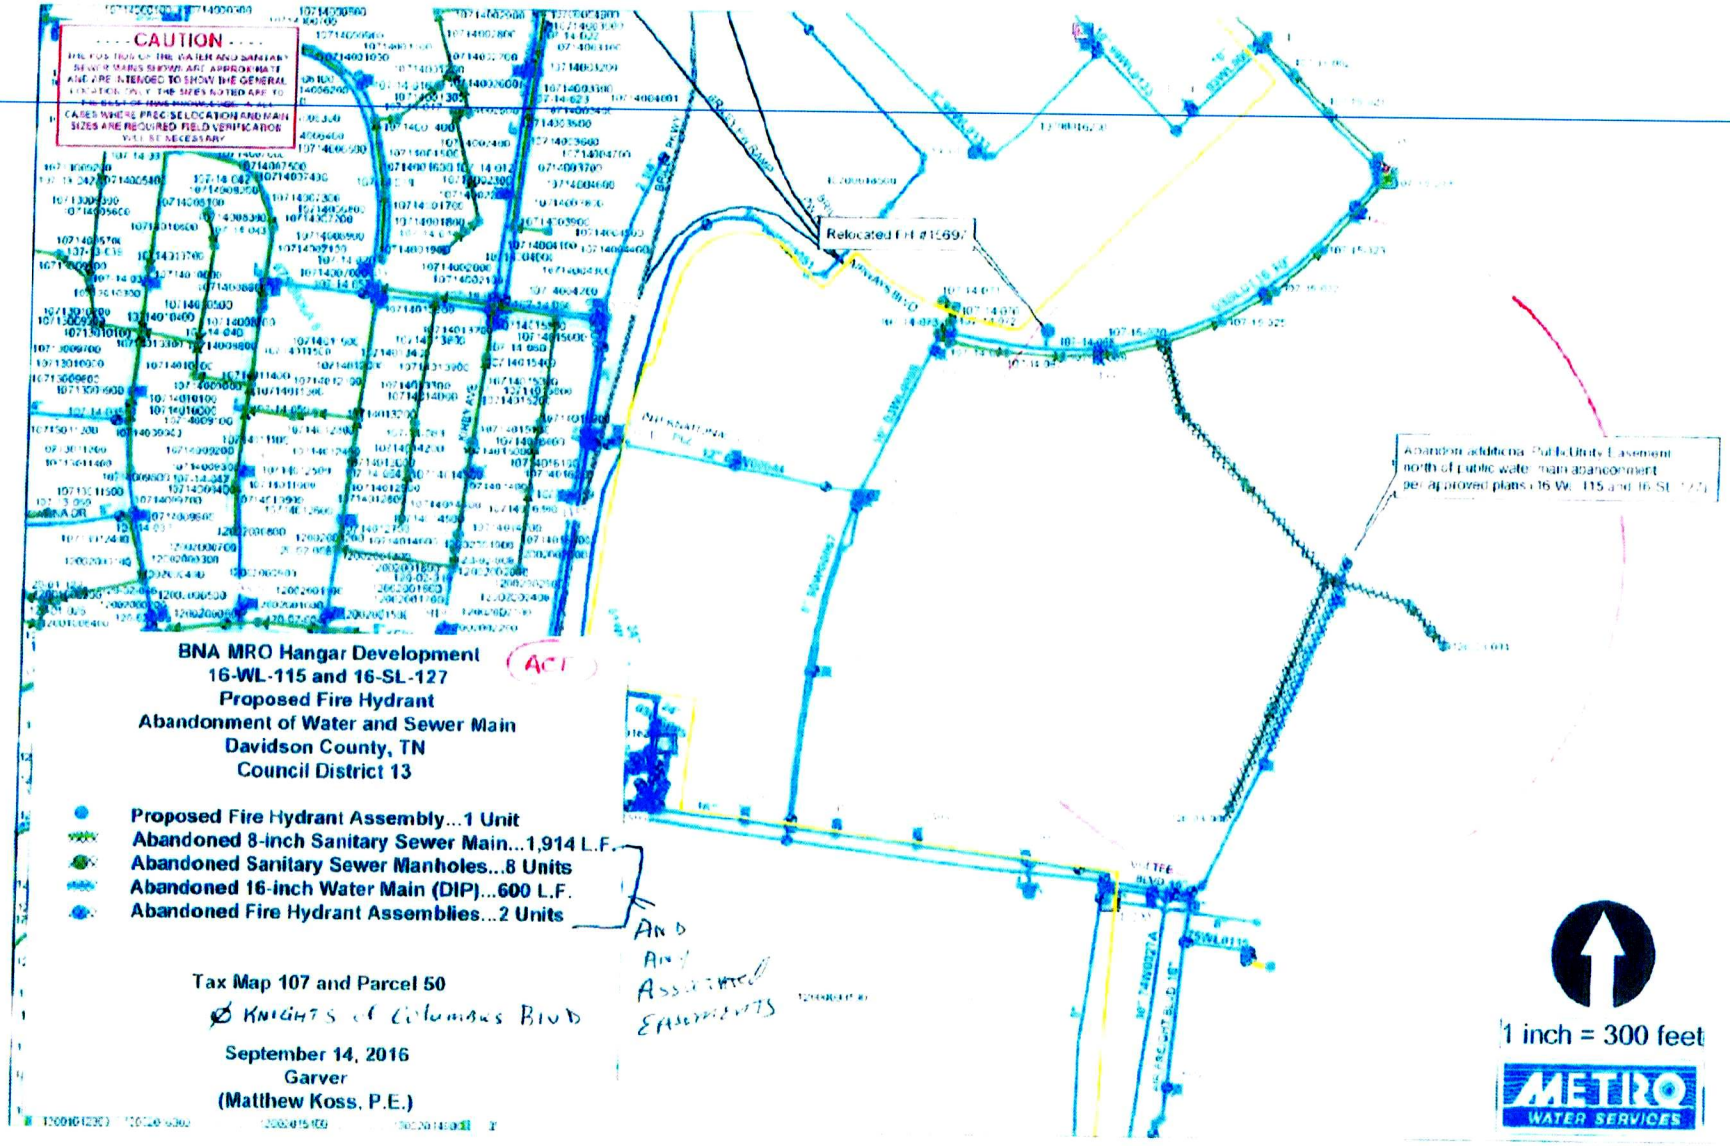
CAUTION
Relocated FH #15697
Abandon additional Public Utility Easement north of public water main abandonment per approved plans 16-WL-115 and 16-SL-127
BNA MRO Hangar Development
16-WL-115 and 16-SL-127
Proposed Fire Hydrant
Abandonment of Water and Sewer Main
Davidson County, TN
Council District 13
ACT
Proposed Fire Hydrant Assembly...1 Unit
Abandoned 8-inch Sanitary Sewer Main...1,914 L.F.
Abandoned Sanitary Sewer Manholes...8 Units
Abandoned 16-inch Water Main (DIP)...600 L.F.
Abandoned Fire Hydrant Assemblies...2 Units
AND
Any
Associated
Easements
Tax Map 107 and Parcel 50
Ø Knights of Columbus Blvd
September 14, 2016
Garver
(Matthew Koss, P.E.)
1 inch = 300 feet
METRO
WATER SERVICES