


CAUTION
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF OUR KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

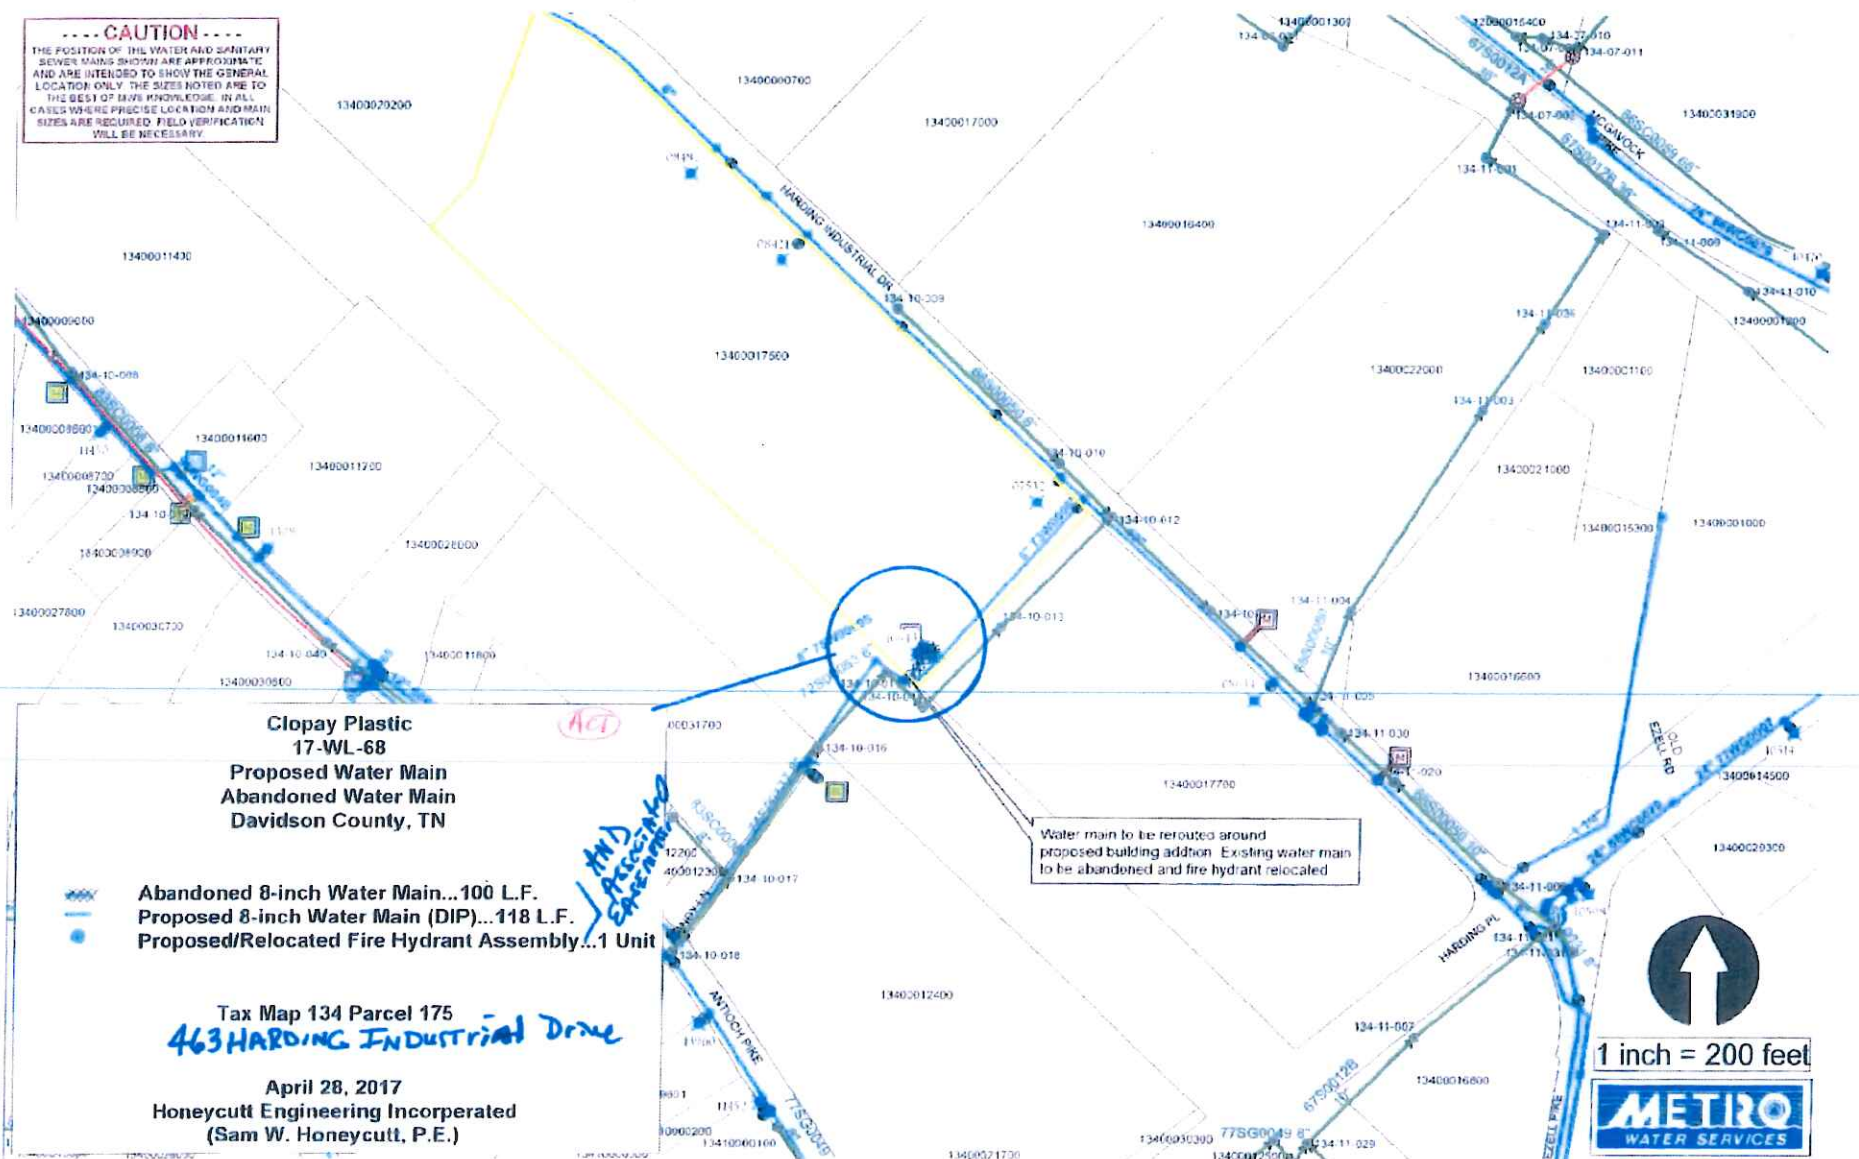

**Clopay Plastic
 17-WL-68
 Proposed Water Main
 Abandoned Water Main
 Davidson County, TN**

- Abandoned 8-inch Water Main...100 L.F.
- Proposed 8-inch Water Main (DIP)...118 L.F.
- Proposed/Relocated Fire Hydrant Assembly...1 Unit

Tax Map 134 Parcel 175
463 HARDING INDUSTRIAL DRIVE

April 28, 2017
 Honeycutt Engineering Incorporated
 (Sam W. Honeycutt, P.E.)

Water main to be rerouted around proposed building addition. Existing water main to be abandoned and fire hydrant relocated.

1 inch = 200 feet