Exhibit 1

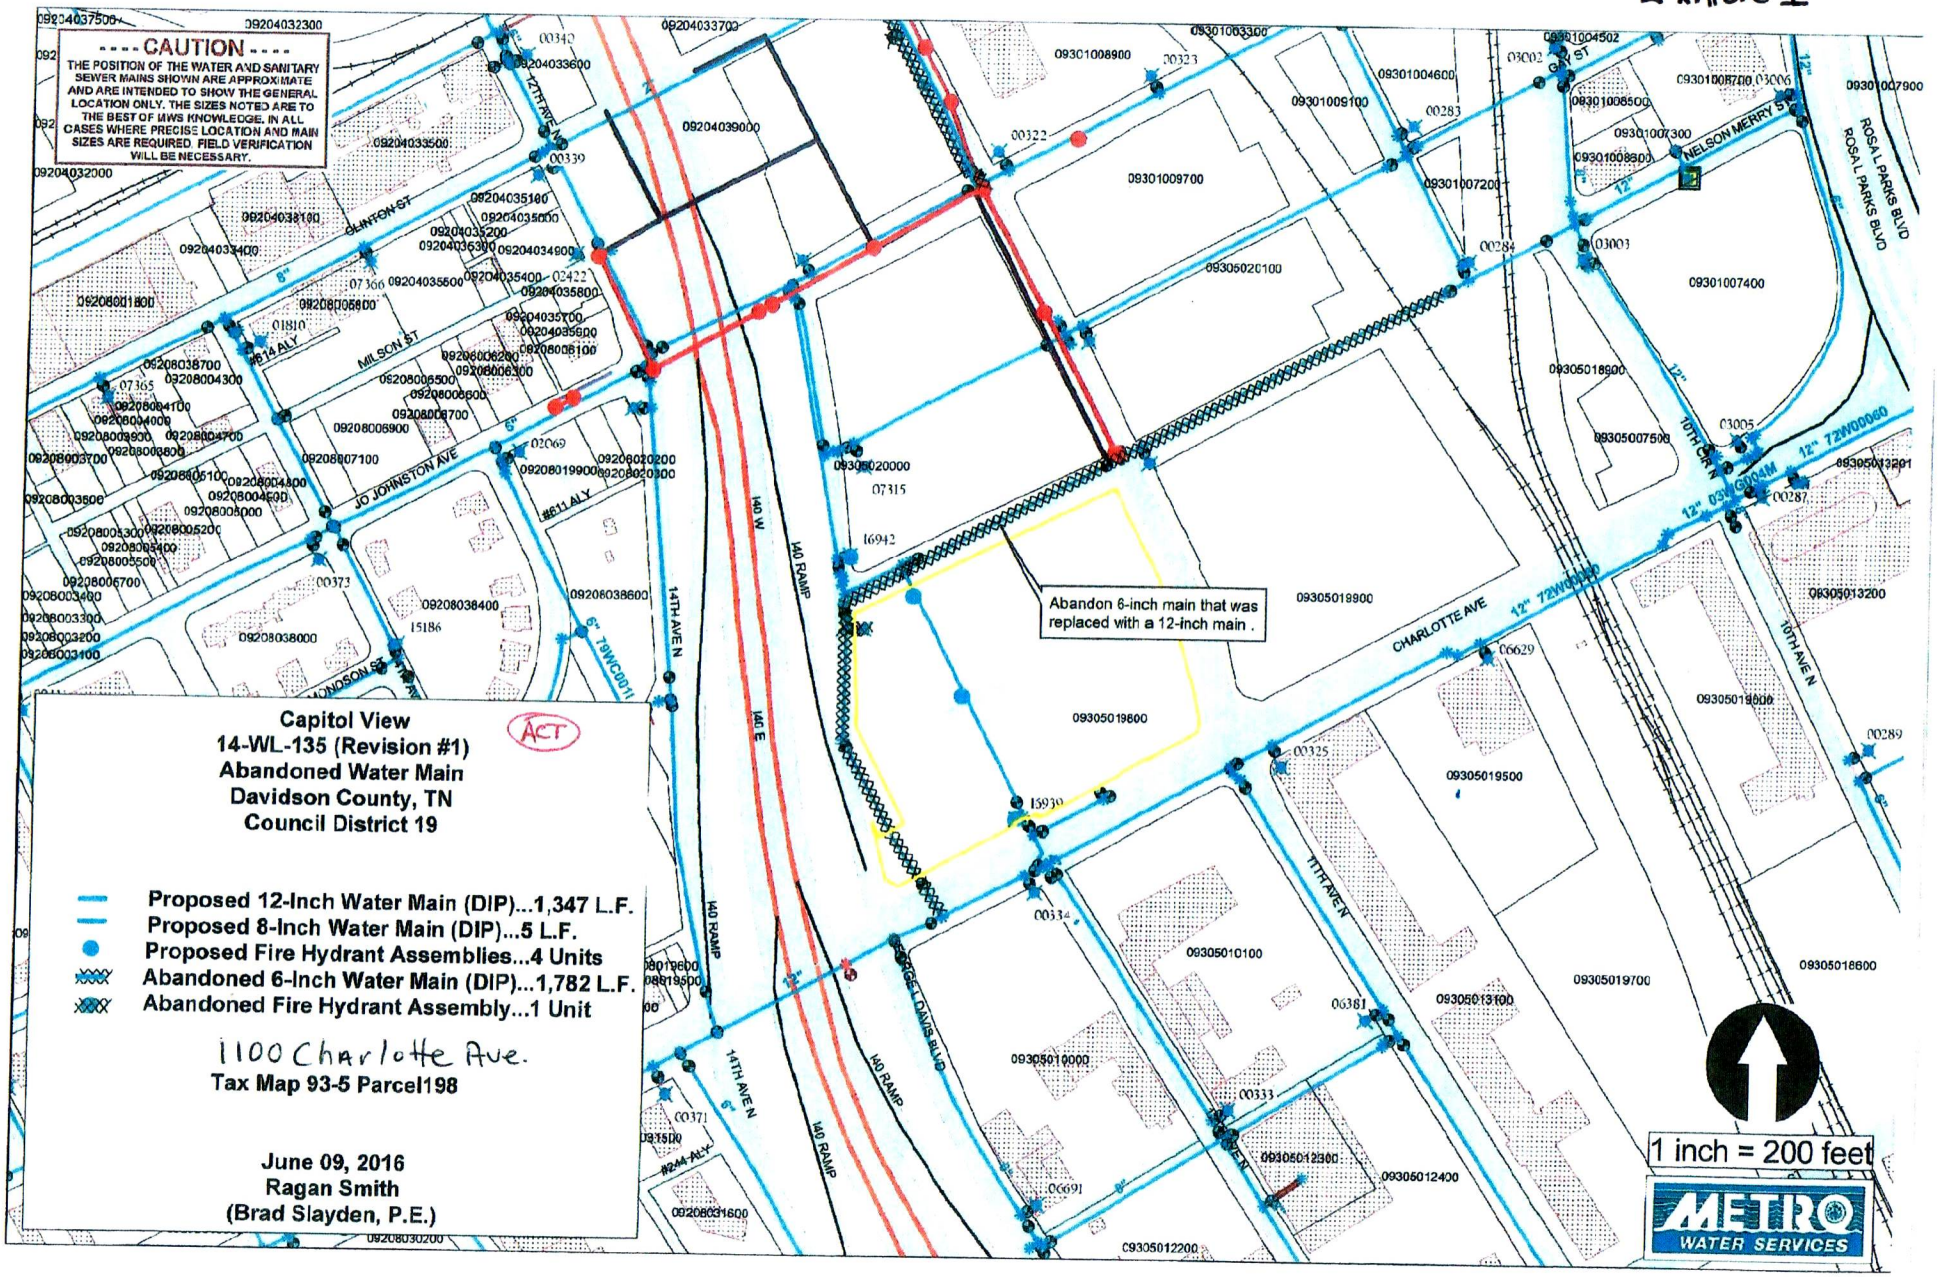
---- CAUTION ----
THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED FIELD VERIFICATION WILL BE NECESSARY.
Abandon 6-inch main that was replaced with a 12-inch main .
Capitol View
14-WL-135 (Revision #1)
Abandoned Water Main
Davidson County, TN
Council District 19
ACT
Proposed 12-Inch Water Main (DIP)...1,347 L.F.
Proposed 8-Inch Water Main (DIP)...5 L.F.
Proposed Fire Hydrant Assemblies...4 Units
Abandoned 6-Inch Water Main (DIP)...1,782 L.F.
Abandoned Fire Hydrant Assembly...1 Unit
1100 Charlotte Ave.
Tax Map 93-5 Parcel198
June 09, 2016
Ragan Smith
(Brad Slayden, P.E.)
1 inch = 200 feet
METRO WATER SERVICES
CHARLOTTE AVE
JO JOHNSTON AVE
MILSON ST
CLINTON ST
NELSON MERRY ST
ROSA L PARKS BLVD
14TH AVE N
12TH AVE N
10TH AVE N
11TH AVE N
GEORGE L DAVIS BLVD
I40 W
I40 E
I40 RAMP